

FEATURES

- Configurable input for RTD, TC, mV, V, mA, Resistance and Potentiometer
- Galvanic isolation
- Configurable output in current or voltage
- Power supply range: 90 ÷ 250 Vac
- Configurable by Personal Computer
- High accuracy
- On-field reconfigurable
- EMC compliant – CE mark
- Suitable for DIN rail mounting in compliance with EN-50022 and EN50035



GENERAL DESCRIPTION

The converter DAT 4135/AC is able to execute many functions such as : measure and linearisation of the temperature characteristic of RTDs sensors, conversion of a linear resistance variation, conversion of a standard active current signal , conversion of a voltage signal even coming from a potentiometer connected on its input. Moreover the DAT 4135/AC is able to measure and linearise the standard thermocouples with internal cold junction compensation. In function of programming, the measured values are converted in a current or voltage signal. The device guarantees high accuracy and performances stability both in time and in temperature.

The programming of the DAT 4135/AC is made by a Personal Computer using the software PROSOFT, developed by DATEXEL, that runs under the operative system "Windows™". By use of PROSOFT, it is possible to configure the converter to interface it with the most used sensors .

In case of sensors with a no-standard output characteristic, it is possible to execute, via software, a "Custom" linearisation (per step) to obtain an output linearised signal .

For Resistance and RTDs sensors it is possible to program the cable compensation with 3 or 4 wires; for Thermocouples it is possible to program the Cold Junction Compensation (CJC) as internal or external.

It is possible to set the minimum and maximum values of input and output ranges in any point of the scale, keeping the minimum span shown in the table below. Moreover it is available the option of alarm for signal interruption (burn-out) that allows to set the output value as high or low out of scale .

The 3000 Vac isolation between input and output eliminates the effects of all ground loops eventually existing and allows the use of the converter in heavy environmental conditions found in industrial applications.

The device must be powered by alternate voltage included between 90 ÷ 250 Vac.

The DAT 4135/AC is in compliance with the standard 89/336/CEE on the Electromagnetic Compatibility.

It is housed in a plastic enclosure of 22.5 mm thickness suitable for DIN rail mounting in compliance with EN-50022 and EN-50035 standards.

USER INSTRUCTIONS

The converter DAT 4135/AC must be powered by an alternate voltage between 90÷250 Vac applied to the terminals R and Q (Vac) as shown in the section "Power supply connections".

The output signal, in voltage or current, is provided to the terminals N(OUT) and M (GND2), as shown in the section "Output connections".

The input connections must be made as shown in the section "Input connections".

To configure, calibrate and install the converter, refer to sections " DAT4135/AC: configuration and calibration" and "Installation Instructions".

TECHNICAL SPECIFICATIONS (Typical at 25 °C and in nominal conditions)

Input type	Min	Max	Min. span	Input calibration (1)	Response time (10÷ 90%)
TC(*) CJC int./ext.				RTD > of ±0.1% f.s. or ±0.2°C	about 400 ms
J	-200°C	1200°C	2 mV	Low res. > of ±0.1% f.s. or ±0.15 Ω	Power supply Power supply 90 .. 250 Vac Power dissipation 2 W max. Protection Internal fuse
K	-200°C	1370°C	2 mV	High res. > of ±0.2% f.s. or ±1 Ω	
S	-50°C	1760°C	2 mV	mV, TC > of ±0.1% f.s. or ±18 uV	Isolation voltage 3000 Vac,50 Hz,1 min
R	-50°C	1760°C	2 mV	Volt > of ±0.1% f.s. or ± 2 mV	
B	400°C	1820°C	2 mV	mA > of ±0.1% f.s. or ± 6 uA	Output Load Resistance (Rload) Current output <= 650 Ω Voltage output >= 3,5 KΩ Limitation current about 25 mA
E	-200°C	1000°C	2 mV	Output calibration Current ± 7 uA Voltage ± 5 mV	
T	-200°C	400°C	2 mV	Input impedance TC, mV >= 10 MΩ Volt >= 1 MΩ Current ~ 50 Ω	Temperature & humidity Operative temperature -20°C .. +70°C Storage temperature -40°C .. +85°C Humidity (not condensed) 0 .. 90 %
N	-200°C	1300°C	2 mV	Linearity (1) TC ± 0.2 % f.s. RTD ± 0.1 % f.s.	
RTD(*) 2,3,4 wires				Line resistance influence TC, mV, V <=0.8 uV/Ohm	Housing Material Self-extinguish plastic Mounting DIN rail in compliance with EN-50022 and EN-50035 Weight about 150 g.
Pt100	-200°C	850°C	50°C	RTD 3 wires 0.05%/Ω (50 Ω balanced max.)	
Pt1000	-200°C	200°C	50°C	RTD 4 wires 0.005%/Ω (100 Ω balanced max.)	Safety In compliance with EN61010-1 Category of installation II Pollution grade 2
Ni100	-60°C	180°C	50°C	RTD excitation current Typical 0.350 mA	
Ni1000	-60°C	150°C	50°C	CJC comp. ± 0.5°C	EMC (for industrial environments) Immunity EN 61000-6-2 Emission EN 61000-6-4
Voltage				Thermal drift (1) Full scale ± 0.01% / °C CJC ± 0.01% / °C	
mV	-400 mV	+400 mV	2 mV	Burn-out values Max. values about 23 mA or 10,8 Vdc Min. values about 0 mA or 0 Vdc	
mV	-100 mV	+700 mV	2 mV	(1) referred to input Span (difference between max. and min. values)	
Volt	- 10 V	+10 V	500 mV		
Potentiometer (Nominal value)					
	0 Ω	200 Ω	10%		
	200 Ω	500 Ω	10%		
	0.5 KΩ	50 KΩ	10%		
RES. 2,3,4 wires					
Low	0 Ω	300 Ω	10 Ω		
High	0 Ω	2000 Ω	200 Ω		
Current					
mA	-10 mA	+24 mA	2 mA		
Output type	Min	Max	Min. span		
Direct current	0 mA	20 mA	4 mA		
Reverse current	20 mA	0 mA	4 mA		
Direct voltage	0 V	10 V	1 V		
Reverse voltage	10 V	0 V	1 V		

(*) For temperature sensors it is possible to set the input range also in F degrees; to made the conversion use the formula: °F = (°C*9/5)+32)

DAT 4135/AC: CONFIGURATION AND CALIBRATION

Warning: during these operations the device must always be powered.

- CONFIGURATION


- 1) Power-on the DAT 4135/AC by an alternate voltage 90 ± 250 Vac. The green led PWR switched-on indicates the correct supplying condition.
- 2) Open the plastic label protection on front side of DAT 4135/AC.
- 3) Connect the interface PRODAT to the Personal Computer and to device (connector PGRM - see section "DAT4135/AC: PROGRAMMING").
- 4) Run the software PROSOFT.
- 5) Set the parameters of configuration.
- 6) Program the device.

- CALIBRATION CONTROL


With software PROSOFT running:

- 1) Connect on the input a calibrator setted with minimum and maximum values referred to the electric signal or to the temperature sensor to measure.
- 2) Set the calibrator at the minimum value.
- 3) Verify that the DAT 4135/AC provides on output the minimum setted value.
- 4) Set the calibrator at the maximum value.
- 5) Verify that the DAT 4135/AC provides on output the maximum setted value.
- 6) In case of regulation of value obtained in the step 3 and 5, use the ZERO and SPAN regulators of software PROSOFT. The variation introduced from these regulators must be calculated as percentage of the input range.
- 7) Program the device with the new parameters.


DAT 4135/AC: PROGRAMMING

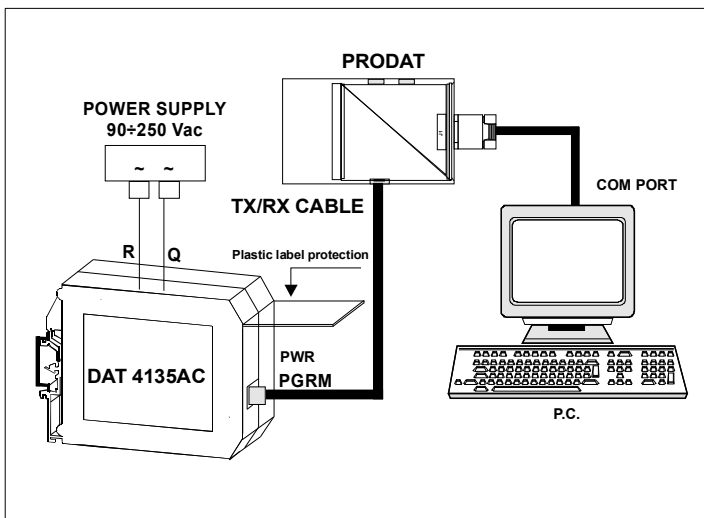

ISOLATION STRUCTURE

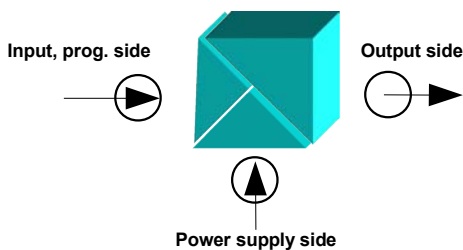

DIMENSIONS (mm) & CONNECTOR PGRM

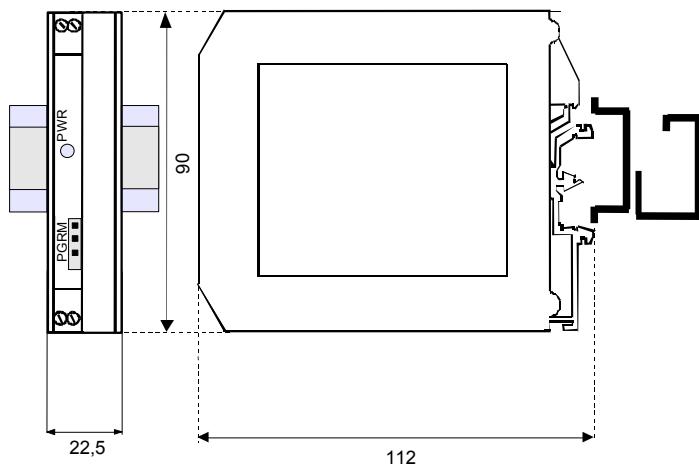


INSTALLATION INSTRUCTIONS

The device DAT 4135/AC is suitable for DIN rail mounting.


It is necessary to install the device in a place without vibrations; avoid to routing conductors near power signal cables.

DAT 4135/AC: CONNECTIONS


INPUT CONNECTIONS

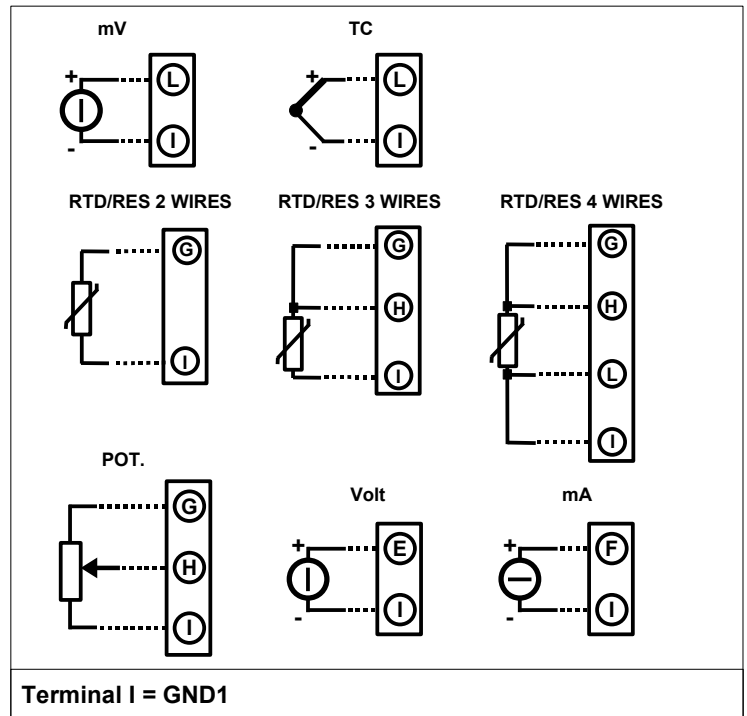

POWER SUPPLY CONNECTIONS

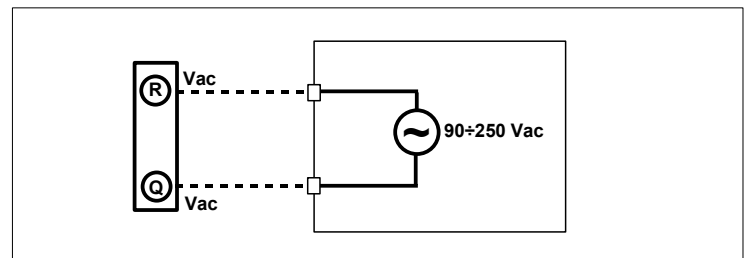

OUTPUT CONNECTIONS

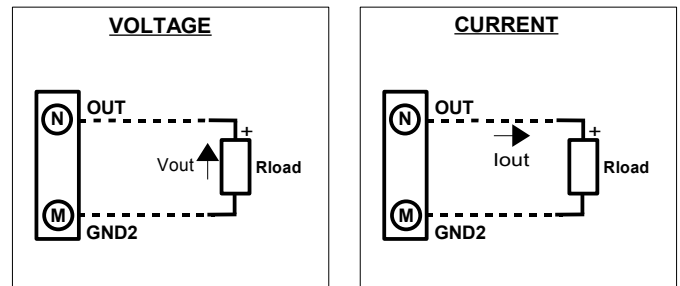

Note: terminal P = O = GND2

HOW TO ORDER

The DAT 4135/AC is provided as requested on the Customer's order. Refer to the section "Technical specification" to determine input and output ranges. In case of the configuration is not specified, the parameters must be set by the user.

ORDER CODE EXAMPLE:

